




Smoke Alarm

User Manual


Basic Information

Appearance

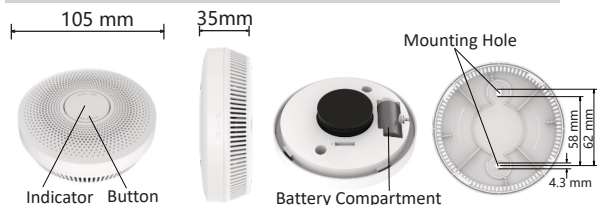

Pack List

*All device's appearances are subject to the one you bought.

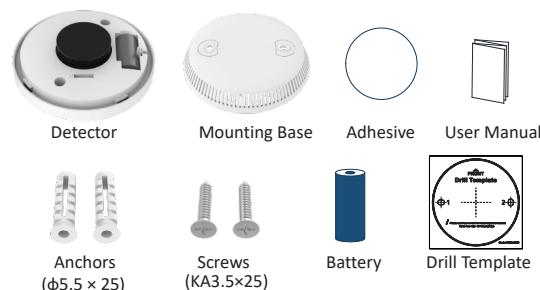

Indicator & Buzzer

Operation Status

Status	Indicator	Buzzer
Standby	Green light flashes every 100s.	Off
Smoke Alarm	Red light is always on.	Quick beeps
Interconnected Smoke Alarm	Red light flashes.	Quick beeps
Low Battery	Yellow light flashes every 50s.	1 quick beep every 50s
Pollution/Sensor Fault	Yellow light flashes every 50s.	Off


Pairing Status

Status	Indicator	Buzzer
Pairing	Green light flashes.	Off
Paired	Green light is always on.	2 quick beeps
Unpaired	Red light flashes 2s.	A long beep

Self Check Status

Status	Indicator	Buzzer
Self Check Process	Red light is on for 5s.	5 quick beeps
Result of self check is normal.	Green light flashes 2s.	Off
Result of self check is fault (Low battery, pollution fault, sensor fault).	Yellow light flashes 2s.	Off
Strong Signal	Green light flashes 2s.	2 quick beeps
Weak Signal	Red light flashes 2s.	3 quick beeps
No Signal	Red light is on for 2s.	A long beep

Icon Definition

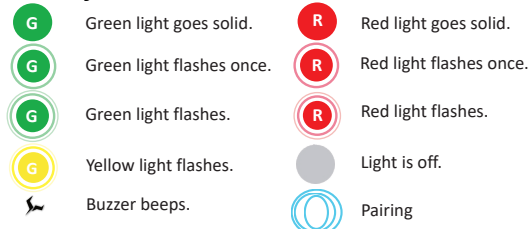

Interconnection

Power on Smoke Alarm

Remove the battery cover and plastic insulated bag, and then install the battery according to anode and cathode marks.
*Replace CR123A battery of major brands purchased from supermarkets.


Interconnection (including 3 scenes)

*When pairing, all alarms need to be operated within 3 meters.


Scene 1 All of alarms are not registered:

1. After finishing pairing the previous alarms, power on the next alarm.
2. After alarms are paired, pairing status keeps 60s.
3. The number of interconnected devices is limited (≤ 30), which could make alarms unpaired.


Step 1 Power on new alarms (Alarm 1, Alarm 2).

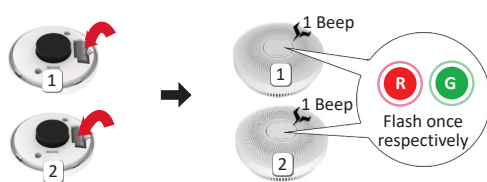

Step 2 Press and hold Alarm1 and Alarm2 for 5s until 3 beeps and release. Short press Alarm1 again until 1 beep in 60s. Check the results.

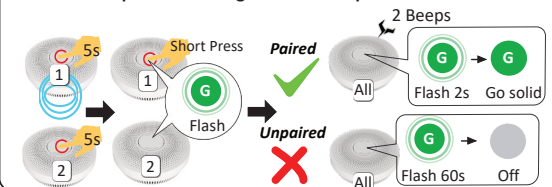

Step 3 Power on Alarm 3/Alarm 4...Alarm N. Repeat Step 2 on them to add to the previous paired alarms one by one.

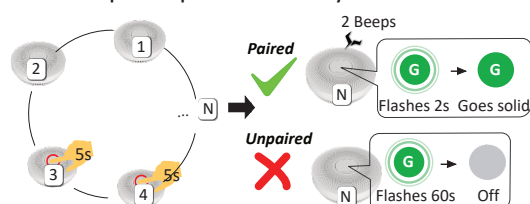


How to Solve Unpaired Situation


- If it is unpaired, you can
1. Check if the alarm is interconnected device.
 2. Check if the working band is consistent with other devices.
 3. Repeat the operations of Step 1.

Scene 2 Add a new alarm to the paired group:


Step 1 Press and hold Alarm 1 for 5s until 3 beeps and release. Short press again until 1 beep in 60s.

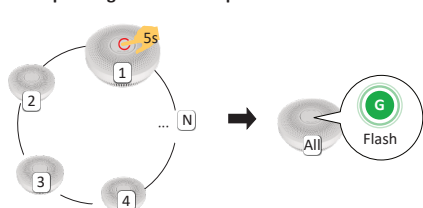

Step 2 Power on new alarm.

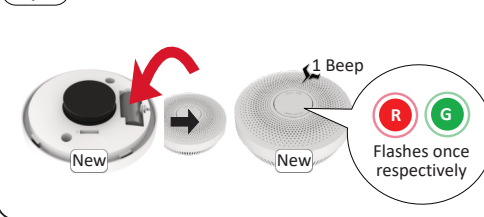

Step 3 Press and hold new alarm for 5s until 3 beeps and release. Short press again until 1 beep in 60s. Check the results.

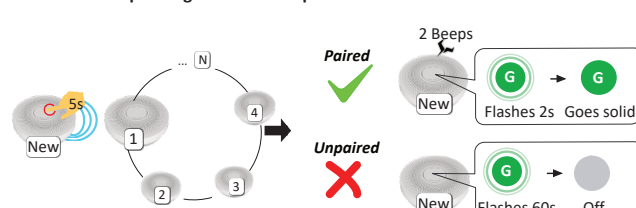


How to Solve Unpaired Situation


- If it is unpaired, you can
1. Check if the alarm is interconnected device.
 2. Check if the working band is consistent with other devices.
 3. Repeat the operations of Step 1.

Scene 3 Two interconnection groups:


Step 1 Respectively select one alarm from every group. Press and hold the two alarms for 5s until 3 beeps and release.

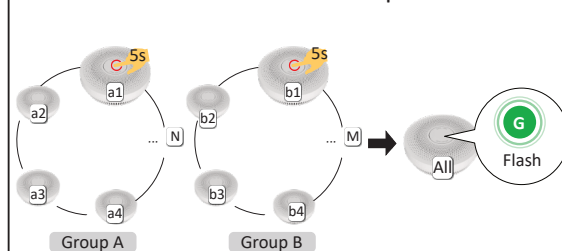

Step 2 Short press the Button of any alarm in the Group A until 1 beep in 60s.

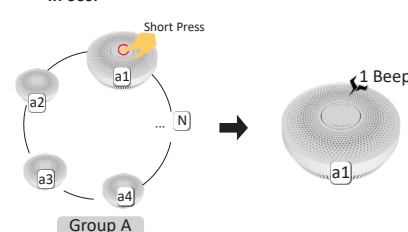

Step 3 Alarm a1 and Alarm b1 of two groups are pairing.

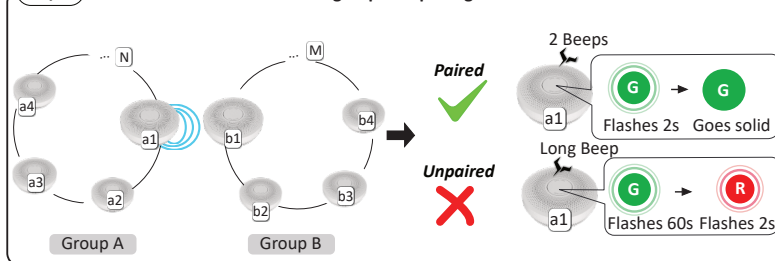


How to Solve Unpaired Situation

- If it is unpaired, you can
1. Check if the alarm is interconnected device.
 2. Check if the working band is consistent with other devices.
 3. Repeat the operations of Step 1.

Test

Self Check

In Standby status, short press the **Button**, alarm starts to self check.
Test sequence: Self check process - check result - signal result.

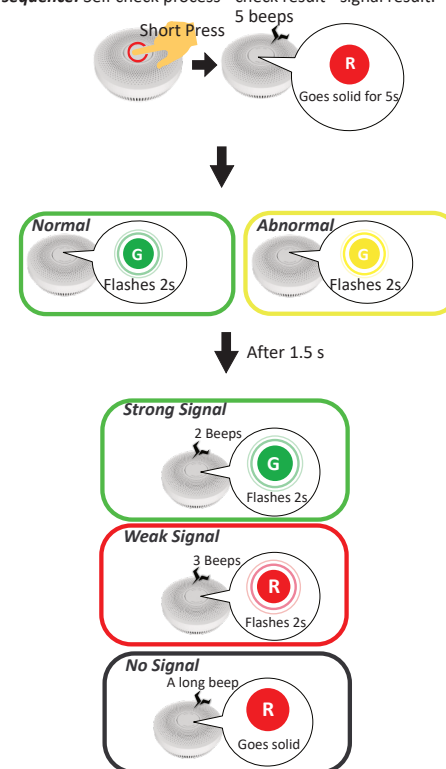

Simulate to Alarm


Simulate to alarm before installation to ensure the alarm can work properly. If not, please contact the supplier in time.

Trigger: Press the **Button** on any interconnected smoke alarm (initiating device) for 10s, the red light is on and buzzer beeps 5 times quickly. After other interconnected devices receive the signal in the group, they all start to alarm. Their red lights flash and buzzers beep quickly.


*If the initiating device does not trigger other devices' alarms, please check the signal strength of the installation position.

Mute: Short press the **Button** on the initiating device to mute all alarms.

Trigger

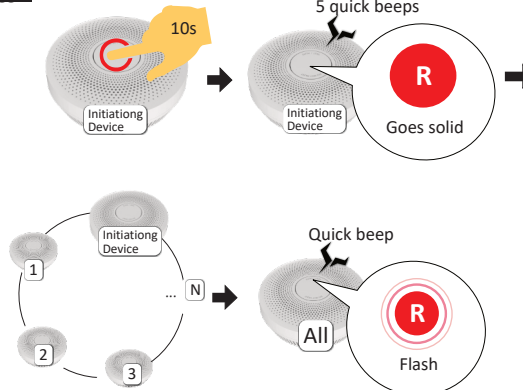

Mute

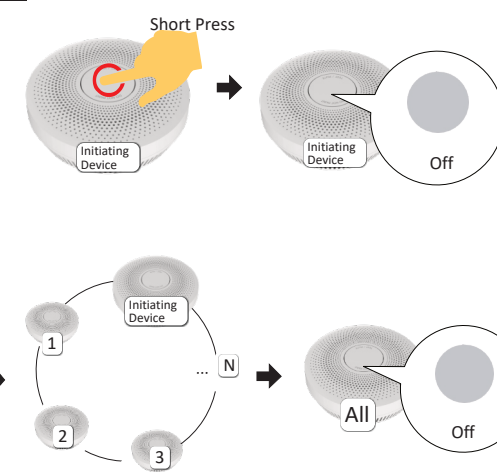

Installation


Installation Location

Notification

- 1. Before installation, confirm that the device and other mounting parts are in good condition.
- 2. The device should be operated by qualified personnel.
- 3. Do not install the device in new or renovated buildings until all work is completed. (Dust and debris from building work can contaminate the smoke chamber).
- 4. Install multiple devices if the installation location (such as ceiling) is longer than 32.81 ft (10 meters).
- 5. The installation location should be at least 30 cm away from the path of strong electrical wires to prevent small insects from gathering due to phototaxis, causing smoke maze pollution and alarms.
- 6. The installation of this device cannot replace proper installation.
 - Where Not to Install:
 - Damp and humid areas such as kitchen, hot water heater, and bathroom.
 - Outdoors.
 - In places with low or unstable signal strength.
 - In places with fast air circulation such as near fans, vents, open windows.
 - Dusty, dirty, or insect infested areas.
 - Hot and greasy areas such as stoves.
 - Places within 1.64 ft (0.5 meters) of the alarm that is obstructed by an object..
 - Within 4.92 ft (1.5 meters) of fluorescent lights.
 - In places without air circulation such as apexes of ceilings, corners of the rooms.
 - Places with significant temperature changes or with temperatures below 0 °C.
 - Places that may generate smoldering fires or cause significant losses if a fire is not reported in a timely manner.
 - In high or inconvenient places.

For Flat Roof


The edge of the alarm should be at least 500 mm away from any wall.

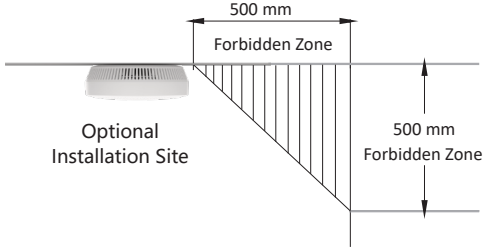

*A single device can cover a 15 meters * 15 meters indoor environment (through one load-bearing wall or one floor slab); when multiple devices are distributed relatively evenly, the signal can cover a maximum of a 3-story * 300 square meter environment.

For Gable Roof


When mounting the alarm device on the top of a gable roof, the distance between the top and the edge of the device should be at least 500 mm.

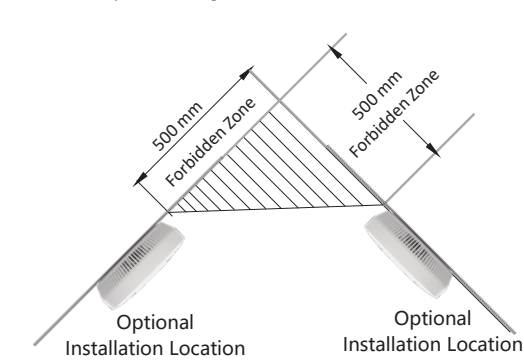

Installation Methods


1. Screws Fixed (Recommended)

- 1 Stick the drilling template onto a clean and flat ceiling surface.
- 2 Drill screw holes according to the template, and insert the anchors.
- 3 Align the U-shaped holes corresponded to the amounting base to the anchors, and then fix the mounting base with the screws.
- 4 Rotate the detector clockwise to completely lock the buckles of the detector and lock grooves on the mounting base.

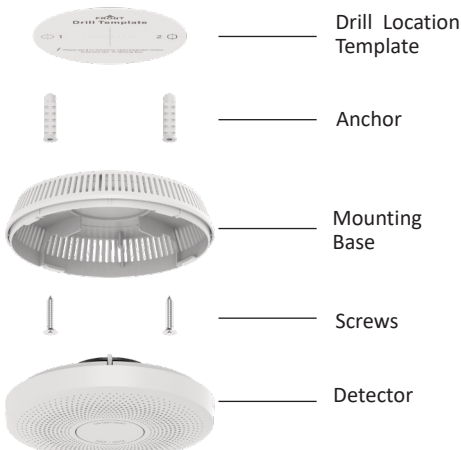

2. Adhesive Fixed

*The optimal temperature range for adhesive bonding is 21 ° C to 38 ° C, and temperatures below 10 ° C are not suitable for bonding.

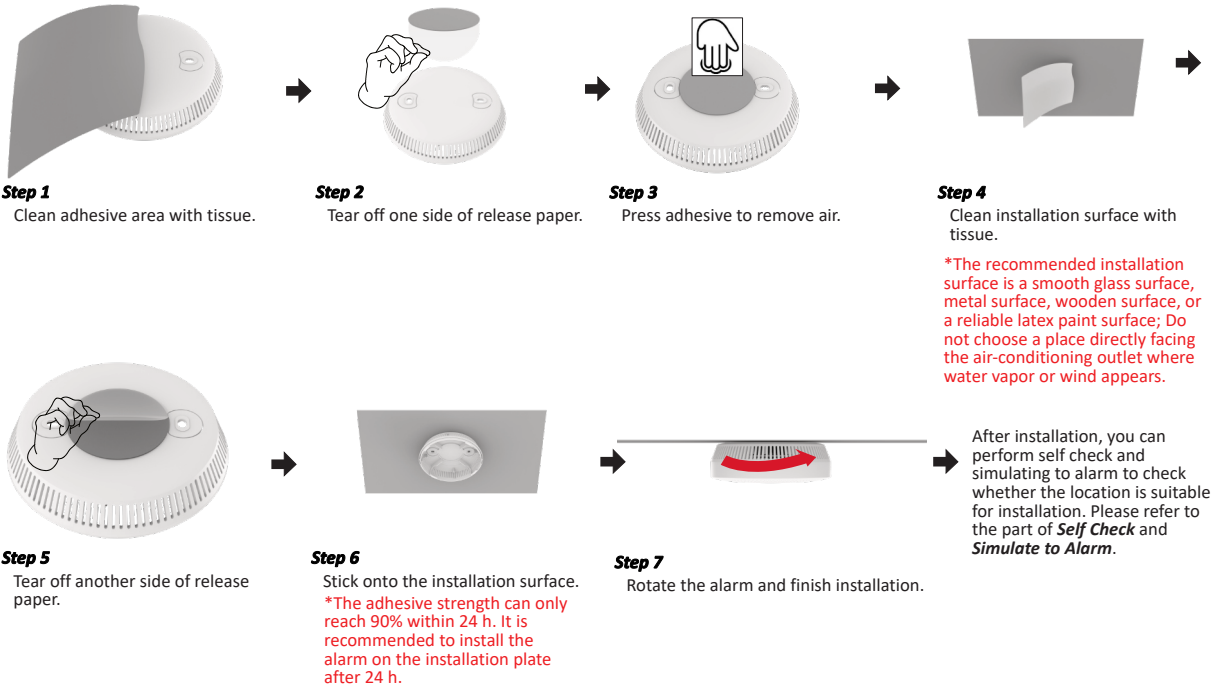

Functions

Smoke Alarm

In **Standby** status, when the smoke concentration reaches the alarm threshold, the alarm will trigger an alarm signal.

Alarm status: The buzzer beeps quickly; The indicator light is red and always on.

*In **Smoke Alarm** status, after the smoke dissipates, the device exists **Smoke Alarm** status and enter **Standby** status. If two or more devices are in the **Interconnected Smoke Alarm** status, after the smoke dissipates around one device, the other devices are still in the **Smoke Alarm** status, then the one device will be in **Interconnected Smoke Alarm** status.

Mute

a) When non-initiating devices are in **Interconnected Smoke Alarm** status, press Button or remote control button to mute non-initiating devices. Initiating device stays **Smoke Alarm** status, which can locate the alarm. Then press Button of initiating device or remote control button to mute all alarms.

b) When initiating device is in **Smoke Alarm** status, press its Button or remote control button twice to mute the device and all the interconnected devices. (Press the button on remote control for the first time to mute non-initiating devices, and press it again to mute the initiating device.)

*When multiple initiating devices trigger smoke alarm, all initiating devices should be muted sperately to make all devices muted.

Mute status: The buzzer will stop beeping; The light is red and it will turn off when the smoke dissipates.

Mute cycle: After the alarm is muted, if the smoke concentration that caused the alert continues, the alarm will reactive after about 12 mins.

Smoke Alarm Reset

When in the mute status, short press Button of initiating device to resume the **Standby** status, and all the interconnected devices reset to the **Standby** status.

Factory Reset

In **Standby** status, keep pressing Button for 5s, the buzzer beeps 3 times and the alarm enter **Pairing** status, then quickly press Button for 3 times in 2s.

Result: The buzzer beeps 2 times and green light flashes 2s. Group ID and **Paired** status are cleared.

Maze Cleaning

When the alarm generates a maze pollution fault, the top cover and dust cover can be opened to clean the maze. After cleaning, carry out self check to confirm if the detector is clean. After successful cleaning, the dust cover and top cover should be installed back in sequence.



Specification

Function	
Interconnection alarm	Yes
Mute	Yes
Pollution fault	Yes
Low battery	Yes
Test	Yes
Battery uninstalled indicator	Yes
Smoke alarm	Yes
Max. number of interconnected units	30 pcs
Radio communication range	Up to 1,000 m in an open space.
General	
Power supply	3V DC, battery CR123A (replaceble)
Battery capacity	1600 mAh
Execution standard	EN 14604: 2005 AS 3786: 2023
Standby current	≤ 12 μA
Alarm current	≤ 50 mA
Alarm mode	Audible & visual alarm
Alarm sound level	≤ 85 dB@3 m (A-Weighted)
Battery life	Eight-year battery life under normal operation
Operation temperature	-10 °C to 55 °C (14 °F to 131 °F)
Operation humidity	≤ 95% relative humidity (RH)
Dimension (φ × H)	105 mm × 35 mm (4.13" × 1.38")
weight	103.7 g (0.23 lb) (with battery)
Installation	Ceiling mounted
Communication mode	Smoke Alarm-HF-S3E-R: 433 MHz Smoke Alarm-HF-S3E-R8: 868 MHz

English Regulatory Compliance and Safety Information

Read all information and instructions in this document carefully before using the device and keep it for further reference.
For more device information and instructions, please visit our website at <https://www.hikvision.com>. You can also refer to other documents (if any) accompanying the device or scan the QR code (if any) on the packaging to get more information.

About this Document

- This Document includes instructions for using and managing the Product. Pictures, charts, images and all other information hereinafter are for description and explanation only.
- The information contained in the Document is subject to change, without notice, due to firmware updates or other reasons. Please find the latest version of the Document at the Hikvision website (<https://www.hikvision.com>). Unless otherwise agreed, Hangzhou Hikvision Digital Technology Co., Ltd. or its affiliates (hereinafter referred to as "Hikvision") makes no warranties, express or implied.
- Please use the Document with the guidance and assistance of professionals trained in supporting the Product.

About this Product

This product can only enjoy the after-sales service support in the country or region where the purchase is made.

Acknowledgment of Intellectual Property Rights

- Hikvision owns the copyrights and/or patents related to the technology embodied in the Products described in this Document, which may include licenses obtained from third parties.
- Any part of the Document, including text, pictures, graphics, etc., belongs to Hikvision. No part of this Document may be excerpted, copied, translated, or modified in whole or in part by any means without written permission.
- **Hikvision** and other Hikvision's trademarks and logos are the properties of Hikvision in various jurisdictions.
- Other trademarks and logos mentioned are the properties of their respective owners.

LEGAL DISCLAIMER

- TO THE MAXIMUM EXTENT PERMITTED BY APPLICABLE LAW, THIS DOCUMENT AND THE PRODUCT DESCRIBED, WITH ITS HARDWARE, SOFTWARE AND FIRMWARE, ARE PROVIDED "AS IS" AND "WITH ALL FAULTS AND ERRORS". HIKVISION MAKES NO WARRANTIES, EXPRESS OR IMPLIED, INCLUDING WITHOUT LIMITATION, MERCHANTABILITY, SATISFACTORY QUALITY, OR FITNESS FOR A PARTICULAR PURPOSE. THE USE OF THE PRODUCT BY YOU IS AT YOUR OWN RISK. IN NO EVENT WILL HIKVISION BE LIABLE TO YOU FOR ANY SPECIAL, CONSEQUENTIAL, INCIDENTAL, OR INDIRECT DAMAGES, INCLUDING, AMONG OTHERS, DAMAGES FOR LOSS OF BUSINESS PROFITS, BUSINESS INTERRUPTION, OR LOSS OF DATA, CORRUPTION OF SYSTEMS, OR LOSS OF DOCUMENTATION, WHETHER BASED ON BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE), PRODUCT LIABILITY OR OTHERWISE, IN CONNECTION WITH THE USE OF THE PRODUCT, EVEN IF HIKVISION HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES OR LOSS.
- YOU ACKNOWLEDGE THAT THE NATURE OF THE INTERNET PROVIDES FOR INHERENT SECURITY RISKS, AND HIKVISION SHALL NOT TAKE ANY RESPONSIBILITY FOR ABNORMAL OPERATION, PRIVACY LEAKAGE OR OTHER DAMAGES RESULTING FROM CYBER-ATTACK, HACKER ATTACK, VIRUS INFECTION, OR OTHER INTERNET SECURITY RISKS; HOWEVER, HIKVISION WILL PROVIDE TIMELY TECHNICAL SUPPORT IF REQUIRED.
- YOU AGREE TO USE THIS PRODUCT IN COMPLIANCE WITH ALL APPLICABLE LAWS, AND YOU ARE SOLELY RESPONSIBLE FOR ENSURING THAT YOUR USE CONFORMS TO THE APPLICABLE LAW. ESPECIALLY, YOU ARE RESPONSIBLE, FOR USING THIS PRODUCT IN A MANNER THAT DOES NOT INFRINGE ON THE RIGHTS OF THIRD PARTIES, INCLUDING WITHOUT LIMITATION, RIGHTS OF PUBLICITY, INTELLECTUAL PROPERTY RIGHTS, OR DATA PROTECTION AND OTHER PRIVACY RIGHTS. YOU SHALL NOT USE THIS PRODUCT FOR ANY PROHIBITED END-USES, INCLUDING THE DEVELOPMENT OR PRODUCTION OF WEAPONS OF MASS DESTRUCTION, THE DEVELOPMENT OR PRODUCTION OF CHEMICAL OR BIOLOGICAL WEAPONS, ANY ACTIVITIES IN THE CONTEXT RELATED TO ANY NUCLEAR EXPLOSIVE OR UNSAFE NUCLEAR FUEL CYCLE, OR IN SUPPORT OF HUMAN RIGHTS ABUSES.
- IN THE EVENT OF ANY CONFLICTS BETWEEN THIS DOCUMENT AND THE APPLICABLE LAW, THE LATTER PREVAILS.

© Hangzhou Hikvision Digital Technology Co., Ltd. All rights reserved.

EXPOSURE TO RADIO FREQUENCY RF

The frequency bands and transmitting power (radiated and/or conducted) nominal limits for the following radio equipment are as follows:

HF-S3E-R/HK-S3E-R/HS-S3E-R: GFSK(433.1MHz-434.7MHz): 10mW
HF-S3E-R8/HK-S3E-R8/HS-S3E-R8: GFSK(865.1MHz-868.6MHz): 25mW

Safety Information

Please read all the safety information carefully before using.

- In the use of the product, you must be in strict compliance with the electrical safety regulations of the nation and region.
- Correctly install and maintain the detector. Although detector can help save lives by providing an early warning of a fire, they are not a substitute for an insurance policy. Home owners should have adequate insurance to protect their lives and properties.
- Install the detector according to the instructions in this manual.
- Please do not place the device in areas that children can touch.
- The detector has multiple power supplies. Please disconnect all power supplies during maintenance.
- Please power off during device wiring and installation.
- Do not place exposed flame sources, such as lit candles, on the device.
- To ensure the normal detection of the detector, do not use a large amount of items such as mousse, insecticides, diluents, etc. that can produce gel like suspended solids near the detector.
- To reduce the risk of fire or electric shock, do not let indoor equipment be exposed to rain or moisture.
- Please do not drop objects onto the device or vigorously vibrate the device, and keep the device away from locations with magnetic field interference. Avoid installing the device in a place that is prone to surface vibration or impact.
- This product is only used to detect the gas concentration in the surrounding environment of the equipment. When the product is in good operating condition, if gas occurs leakage, the detector can emit sound and light alarm signals.
- The carbon monoxide alarm information with a silent alarm device should include a warning. If there is any doubt about the cause of the alarm, it should be assumed that the alarm is caused by the hazardous level of carbon monoxide and residential areas should be evacuated.
- Carbon monoxide is harmful to the body. This device may not be able to prevent the chronic effects of carbon monoxide exposure, and it may not fully protect individuals in special danger.
- If there is any doubt about the cause of the alarm, it should be assumed that the alarm is caused by the hazardous level of carbon monoxide and residential areas should be evacuated.
- Keep the packing so that in case of any problem, pack the detector in its original packing and send it to the agent or return it to the factory for disposal.
- If the detector does not work properly, contact the dealer or the nearest service center. Never attempt to disassemble the detector yourself. (We shall not assume any responsibility for problems caused by unauthorized repair or maintenance.)

BATTERY INSTALLATION AND REPLACEMENT

Install Battery

Tear off the battery insulation, put the battery into the battery holder and insert it to the end.

Replace Battery

Remove the battery from battery holder and replace it with the CR123A battery purchased by a regular manufacturer after 30 seconds. Test the detector for correct operation using the TEST/MUTE button whenever the batteries are replaced after re-fitting the detector onto the battery holder. If the detector is not working properly, please contact the technical support.

- 1. CAUTION: Risk of explosion if the battery is replaced by an incorrect type.
- 2. Improper replacement of the battery with an incorrect type may defeat a safeguard (for example, in the case of some lithium battery types).
- 3. Do not dispose of the battery into fire or a hot oven, or mechanically crush or cut the battery, which may result in an explosion.
- 4. Do not leave the battery in an extremely high temperature surrounding environment, which may result in an explosion or the leakage of flammable liquid or gas.
- 5. Do not subject the battery to extremely low air pressure, which may result in an explosion or the leakage of flammable liquid or gas.
- 6. Dispose of used batteries according to the instructions.
- 7. identifies the battery holder itself and identifies the positioning of the cell(s) inside the battery holder.
- 8. + identifies the positive terminal(s) of equipment which is used with, or generates direct current.
- identifies the negative terminal(s) of equipment which is used with, or generates direct current.

User Manual

